





# ACTSmart Controller Installation

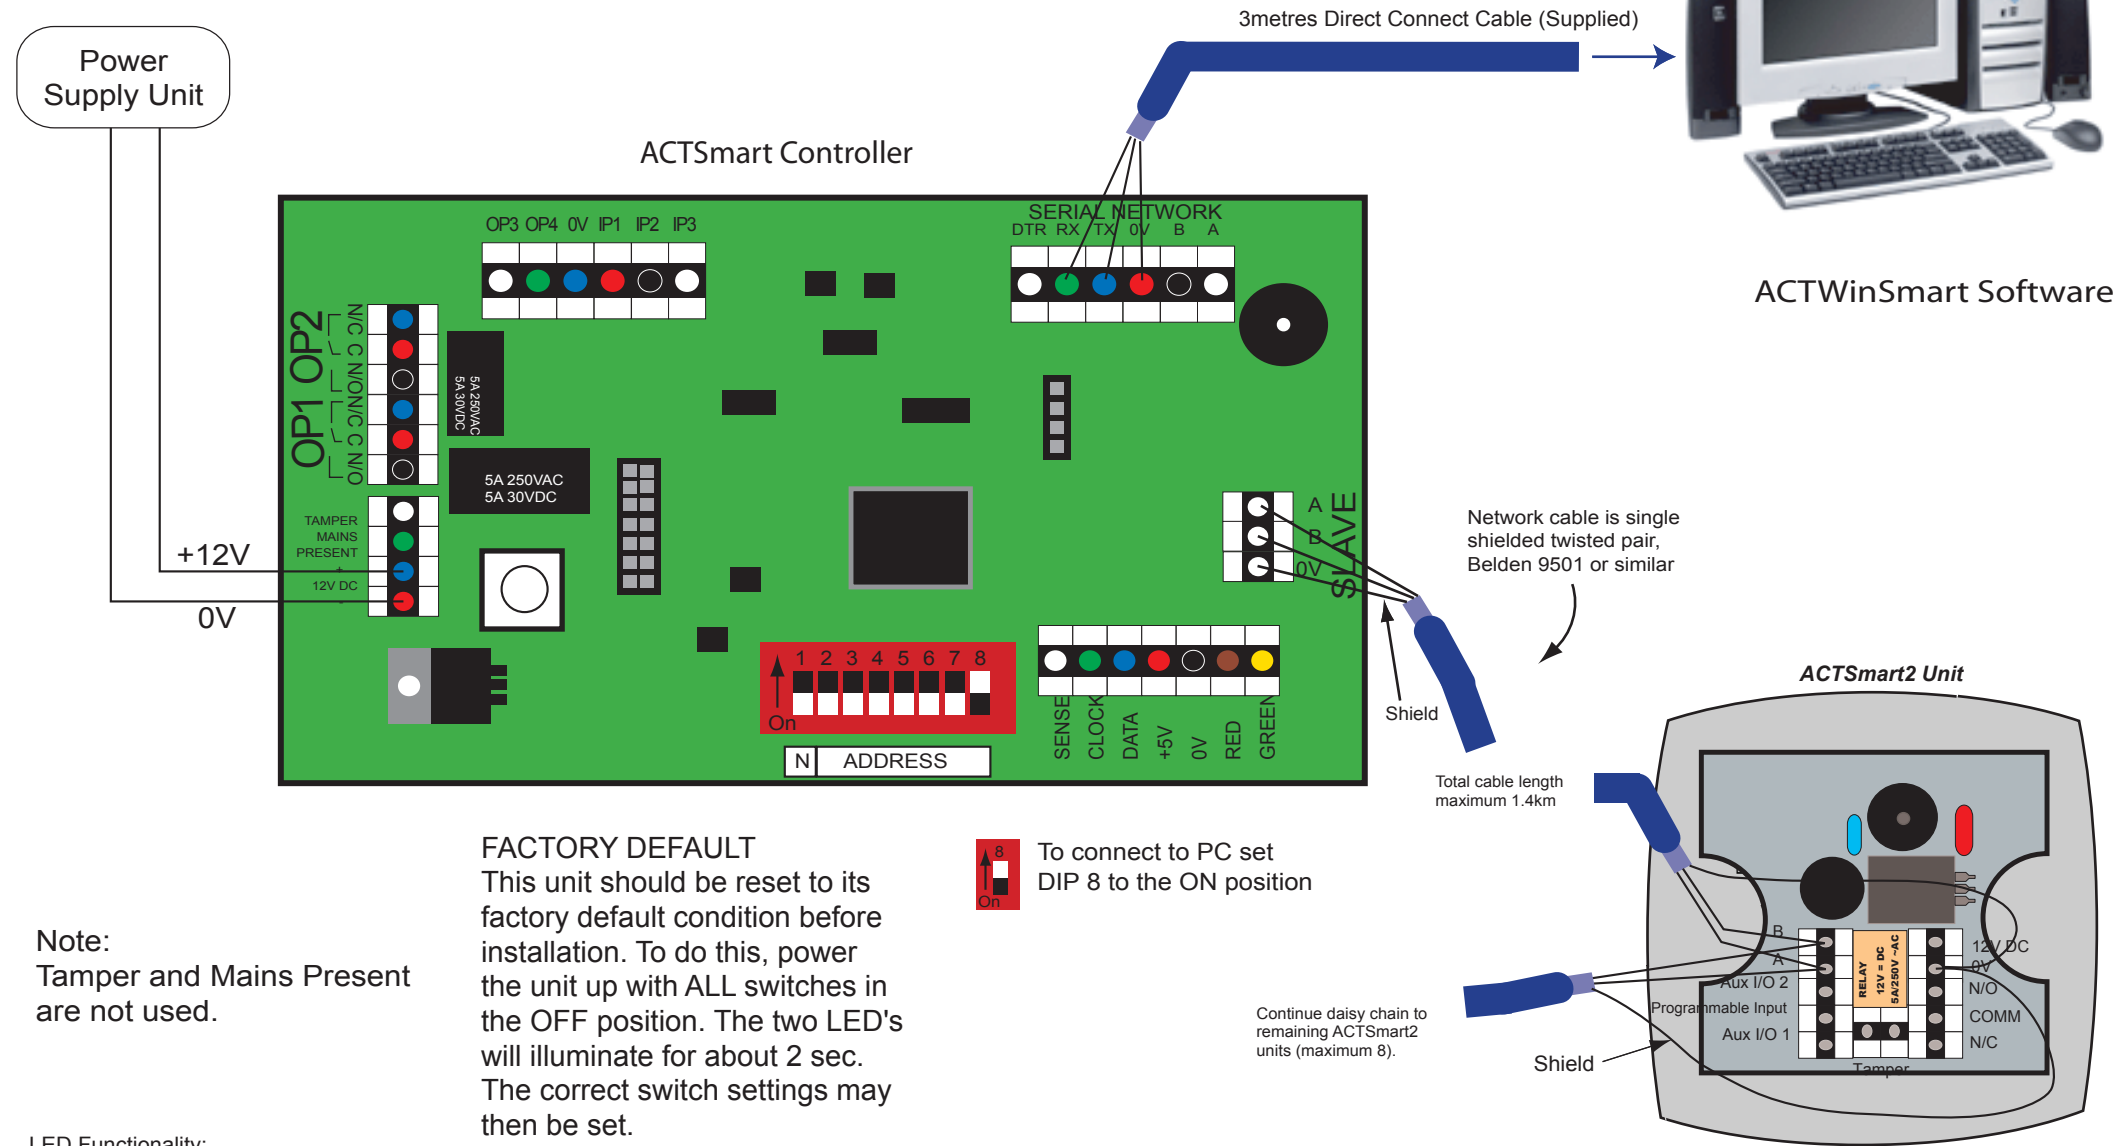

Note:  
Tamper and Mains Present  
are not used.

**FACTORY DEFAULT**  
This unit should be reset to its factory default condition before installation. To do this, power the unit up with ALL switches in the OFF position. The two LED's will illuminate for about 2 sec. The correct switch settings may then be set.

**LED Functionality:**  
Red LED indicates the status of communications with the PC.  
Green LED indicates the status of communications with the ACTSmart Units.  
Normally they flash rapidly.  
If there is a problem they will flash slowly (about once a second).

 To connect to PC set  
DIP 8 to the ON position

Continue daisy chain to  
remaining ACTSmart2  
units (maximum 8).

See ACTSmart2 Installation  
Manual for connection details.